





TYPE M  
KINGFISHER AURIGA

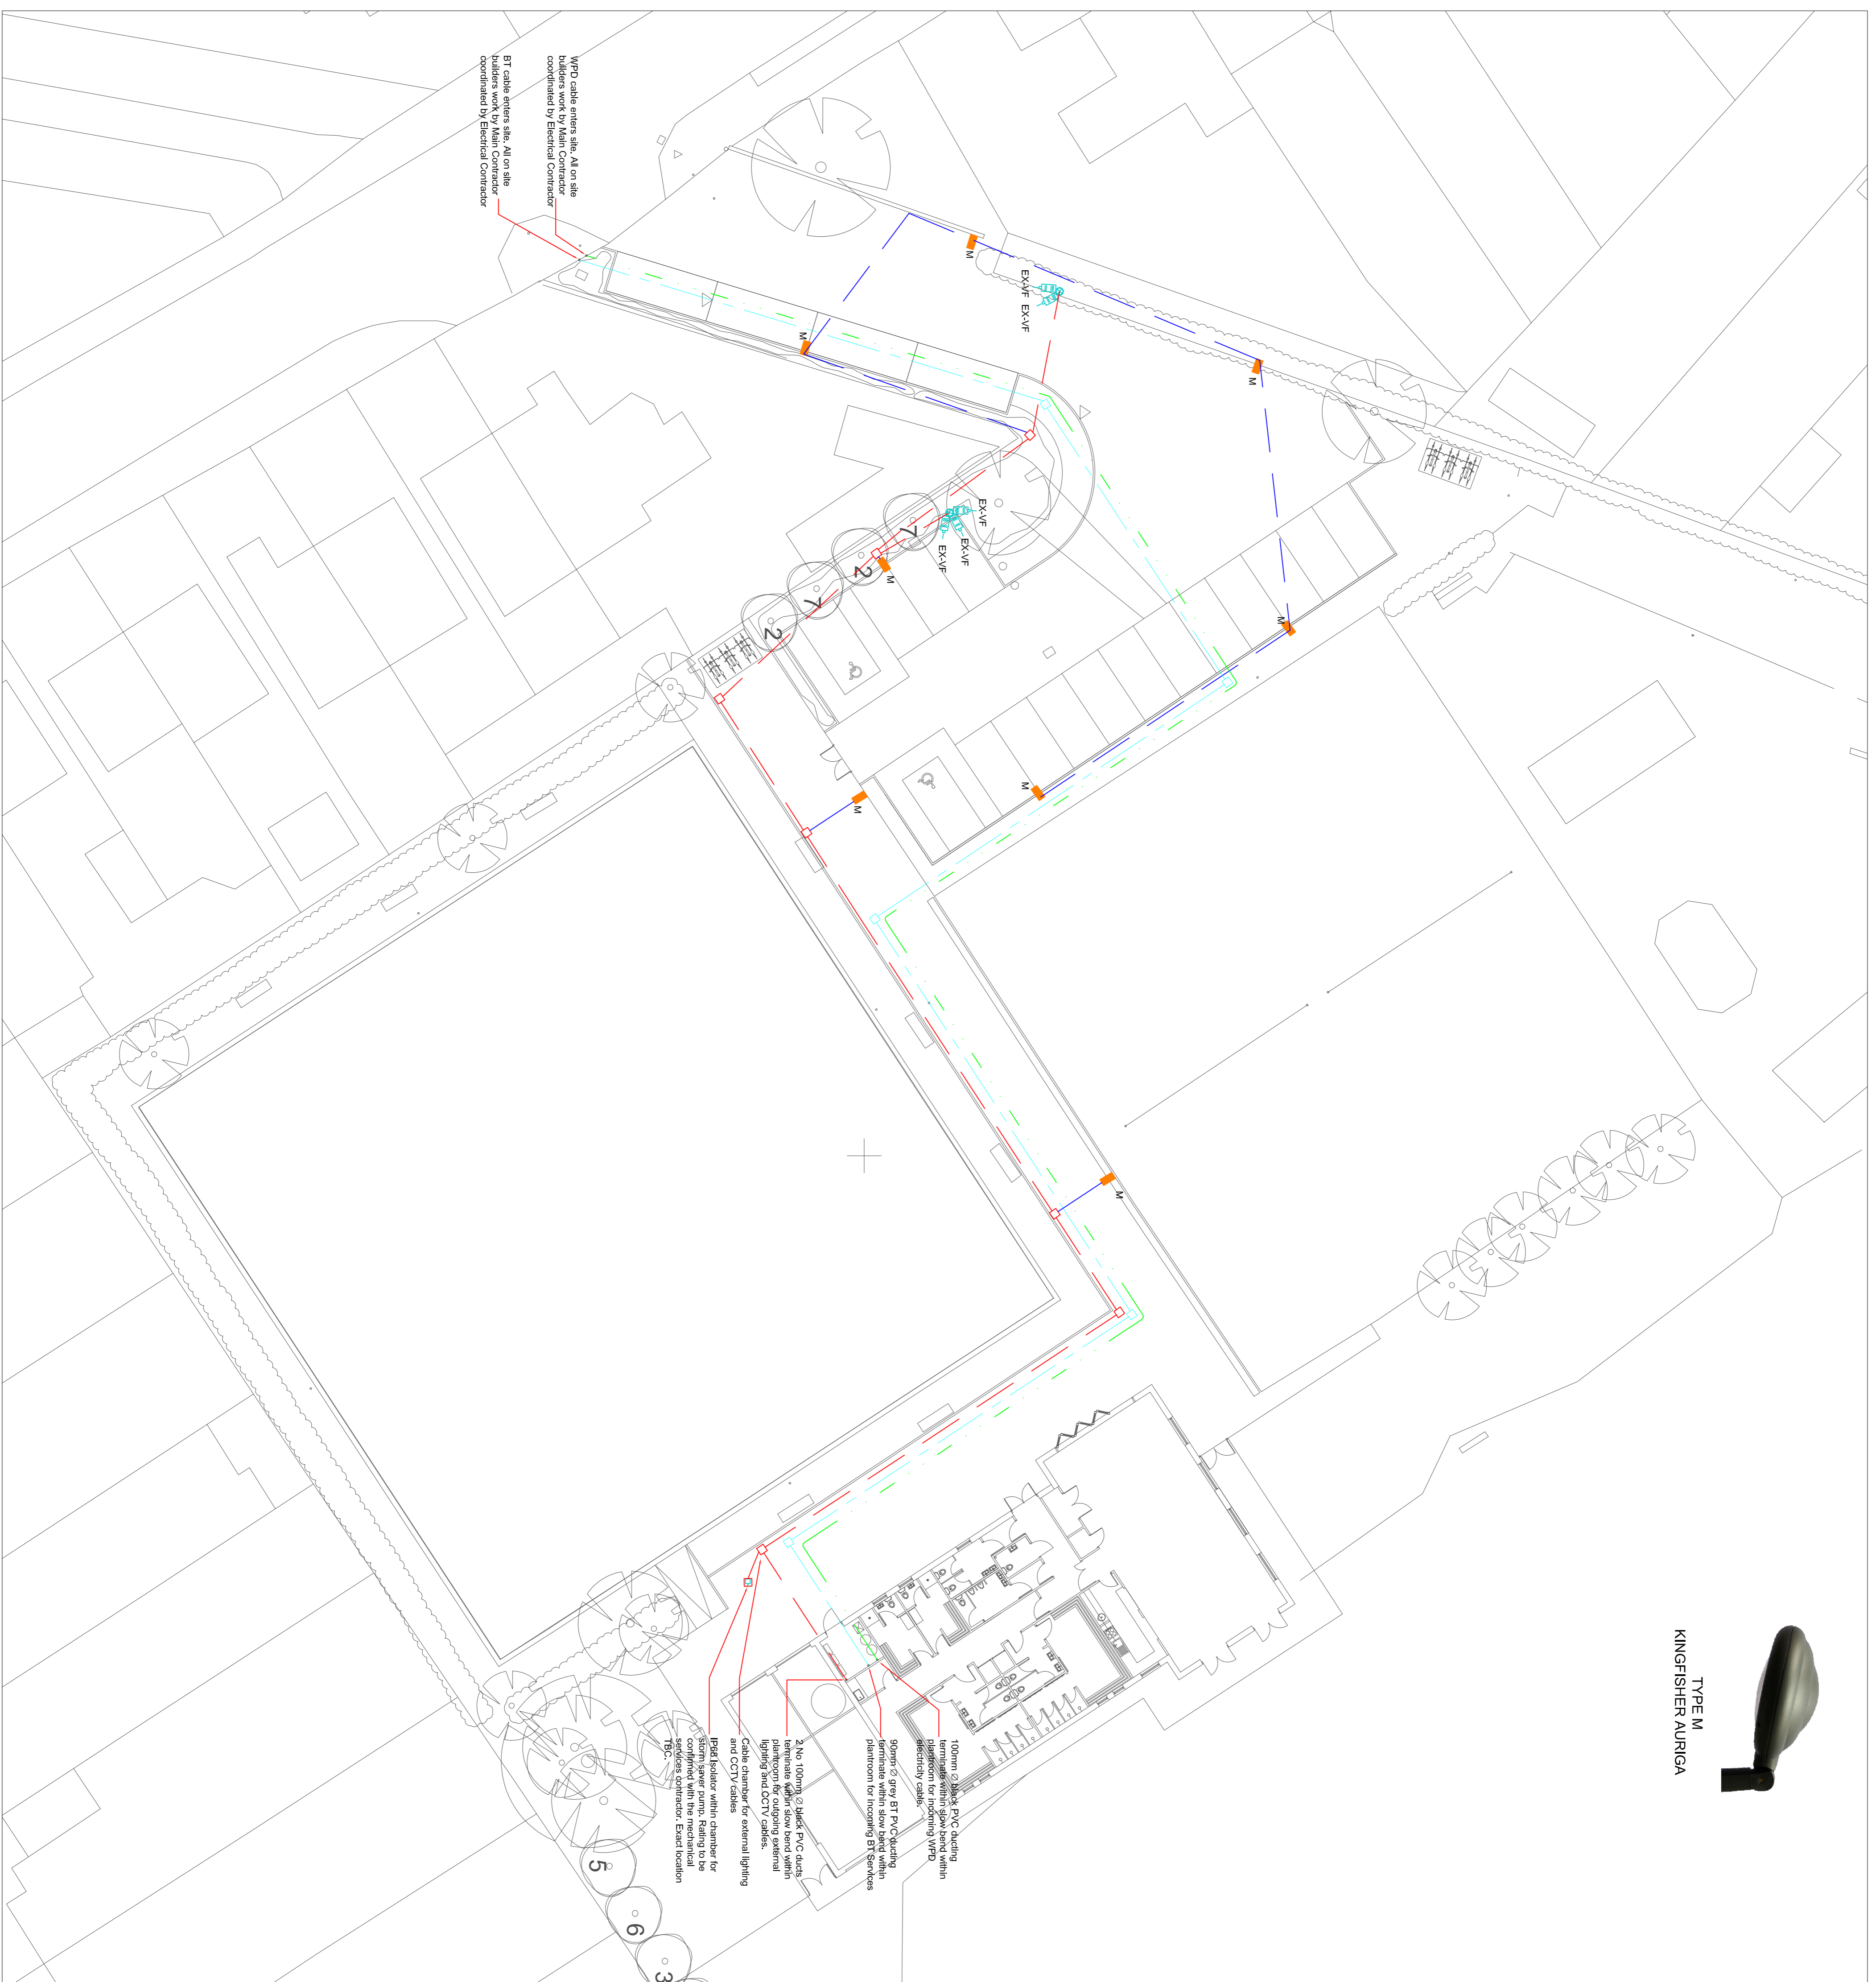

LEGEND:

- 2 No. 100mm Ø black PVC ducts for external lighting and CCTV cabling, CCTV signal cable to be contained within separate duct to CCTV and external lighting mains voltage cabling.
- 1 No. 100mm Ø black PVC duct for external lighting mains voltage cabling.
- 1 No. 100mm Ø black PVC duct for incoming 100mm Ø black PVC duct for incoming WPD electrically supply cable
- 1 No. 90mm Ø grey BT PVC duct for incoming BT Openreach telecoms cable
- 600x600 Cable chamber for external lighting and CCTV cabling
- Cable chamber for incoming BT Openreach services. Size and details to be to BT Openreach specification
- External lighting lantern on 6m meter drop-down column.
- External vertical CCTV camera

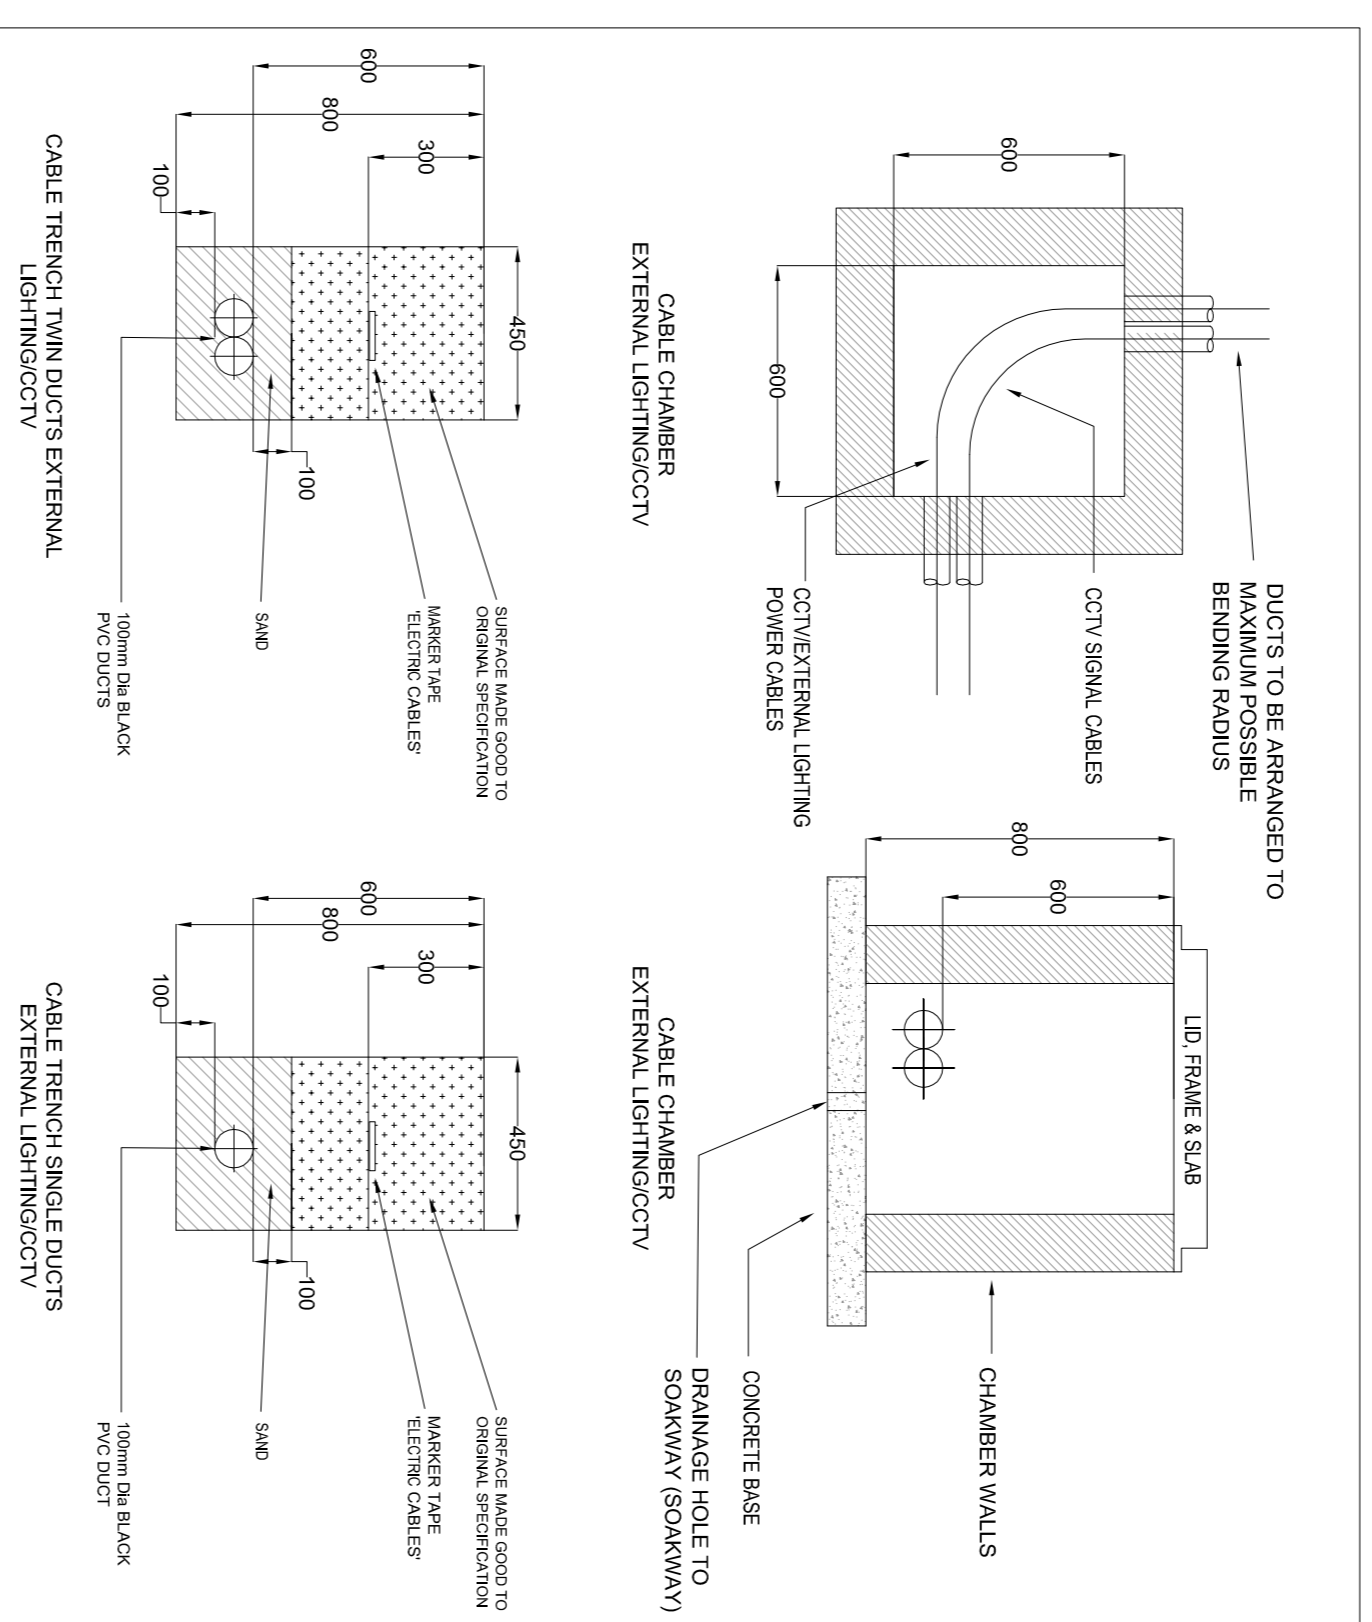

NOTES

1. DRAWING TO BE READ IN CONJUNCTION WITH THE ELECTRICAL SPECIFICATION AND ALL OTHER ELECTRICAL DRAWINGS
2. FOR CABLE TRENCH AND CABLE CHAMBER DETAILS FOR BT COMPANIES SPECIFICATION.

no.	description	date	drawn	approved
A	Tender Issue	Dec-17	NR	AW

Information  approval  tender  contract  construction

**Axis Mechanical & Electrical Consulting Engineers**  
 No. 8 Poplars Court  
 Lenton Lane  
 Nottingham  
 NG7 2BK  
 United Kingdom  
 Tel: +44 (0) 115 9731975  
 Fax: +44 (0) 115 9731976  
 email: mail@axisconsult.co.uk  
 web: www.axisconsult.co.uk

**AXIS**  
M&E Consulting Engineers

**msp architects**

**client**  
 NEW SPORTS PAVILION  
 BRAUNSTONE

**drawing**  
 ELECTRICAL SERVICES  
 PROPOSED SITE PLAN SHOWING CCTV, EXTERNAL  
 AND INCOMING UTILITY SERVICES.

drawn	approved	date	scale
N.R.	A.W.	OCT17	1:200@A1

drawing ref. AX1725-E-04  
 revision A